

**ADDRESS:** 8 North Science Avenue, Laguna Technopark Inc., Brgy. Biñan (Poblacion), Biñan City, Laguna

**CONTACT NO.:** (049) 543-1916

**WEBSITE:** [www.lagunawater.com.ph](http://www.lagunawater.com.ph)

**CUSTOMER NAME** : Laguna Water Corporation

**ADDRESS** : G/F, One Evotech Building, Nuvali, Brgy. Sto. Domingo, Sta. Rosa City, Laguna

**ATTENTION** : N/A

## SUMMARY OF LABORATORY ANALYSIS

**SAMPLE CODE(S)** : S25-4572

**DATE/TIME SUBMITTED** : 07/14/2025 13:33

**DATE/TIME COLLECTION** : 07/14/2025 10:39

**COLLECTED BY** : Edwin O. Aguilar

**NO. OF SAMPLES** : 1

**TOTAL PARAMETERS TESTED** : 4

**SAMPLE LOCATION** : PHASE 1, APO ST., AYALA GREENFIELD ESTATES, BRGY. PUTING LUPA, CALAMBA CITY, LAGUNA

**SAMPLE CHARACTERISTICS** : 100 mL water sample in clear, polystyrene, sterile container with 3% sodium thiosulfate

PARAMETER(S)	UNIT(S)	RESULT(S)	PNSDW LIMIT(S)	METHOD(S)	ANALYSIS	
					DATE	BY
*Residual Chlorine	mg/L	0.61	0.30 – 1.50	4500-Cl-G.DPD Colorimetric	07/14/2025	EOA
Total Coliform	Coliforms/100 mL	ABSENCE	ABSENCE	9223B. Enzyme Substrate Test (Colilert- 18®)	07/14/2025	SBA
Thermotolerant Coliform / <i>Escherichia coli</i>	Coliforms/100 mL	ABSENCE	ABSENCE	9223B. Enzyme Substrate Test (Colilert- 18®)	07/14/2025	SBA
Heterotrophic Plate Count (HPC) <sup>A</sup>	Colony Forming Unit (CFU)/mL	< 1	<500 (cfu/mL)	9215B. Pour Plate Method	07/14/2025	SBA

**REMARKS:** Sample collection was performed by LWC accredited samplers and was analyzed as submitted.

**NOTE:** A – Method is not part of DENR-ELR Recognized Parameters

\*- Performed onsite

**DEVIATIONS:** No deviations noted on sample collection and submission.

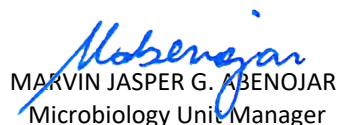
**METHOD REFERENCE:** Standard Methods for the Examination of Water and Wastewater, 24<sup>th</sup> Edition

**STANDARD REFERENCE:** Standard Limit is based on Philippine National Standards for Drinking Water of 2017

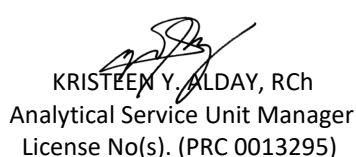
NOT VALID WITHOUT QR CODE

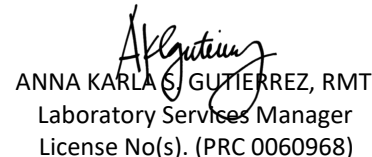


REVIEWED BY:

  
MARVIN JASPER G. ABENOJAR  
Microbiology Unit Manager

CERTIFIED CORRECT BY:

  
KRISTEEN Y. ALDAY, RCh  
Analytical Service Unit Manager  
License No(s). (PRC 0013295)

  
ANNA KARLA S. GUTIERREZ, RMT  
Laboratory Services Manager  
License No(s). (PRC 0060968)

**ADDRESS:** 8 North Science Avenue, Laguna Technopark Inc., Brgy. Biñan (Poblacion), Biñan City, Laguna

**CONTACT NO.:** (049) 543-1916

**WEBSITE:** [www.lagunawater.com.ph](http://www.lagunawater.com.ph)

**CUSTOMER NAME** : Laguna Water Corporation

**ADDRESS** : G/F, One Evotech Building, Nuvali, Brgy. Sto. Domingo, Sta. Rosa City, Laguna

**ATTENTION** : N/A

## SUMMARY OF LABORATORY ANALYSIS

**SAMPLE CODE(S)** : S25-4573

**DATE/TIME SUBMITTED** : 07/14/2025 13:33

**DATE/TIME COLLECTION** : 07/14/2025 10:27

**COLLECTED BY** : Edwin O. Aguilar

**NO. OF SAMPLES** : 1

**TOTAL PARAMETERS TESTED** : 4

**SAMPLE LOCATION** : BLOCK 11, KANLAON ST., AYALA GREENFIELDS ESTATE, BRGY. PUTING LUPA, CALAMBA CITY, LAGUNA

**SAMPLE CHARACTERISTICS** : 100 mL water sample in clear, polystyrene, sterile container with 3% sodium thiosulfate

PARAMETER(S)	UNIT(S)	RESULT(S)	PNSDW LIMIT(/S)	METHOD(S)	ANALYSIS	
					DATE	BY
*Residual Chlorine	mg/L	0.55	0.30 – 1.50	4500-Cl-G.DPD Colorimetric	07/14/2025	EOA
Total Coliform	Coliforms/100 mL	ABSENCE	ABSENCE	9223B. Enzyme Substrate Test (Colilert-18®)	07/14/2025	SBA
Thermotolerant Coliform / <i>Escherichia coli</i>	Coliforms/100 mL	ABSENCE	ABSENCE	9223B. Enzyme Substrate Test (Colilert-18®)	07/14/2025	SBA
Heterotrophic Plate Count (HPC) <sup>A</sup>	Colony Forming Unit (CFU)/mL	< 1	<500 (cfu/mL)	9215B. Pour Plate Method	07/14/2025	SBA

**REMARKS:** Sample collection was performed by LWC accredited samplers and was analyzed as submitted.

**NOTE:** A – Method is not part of DENR-ELR Recognized Parameters

\*- Performed onsite

**DEVIATIONS:** No deviations noted on sample collection and submission.

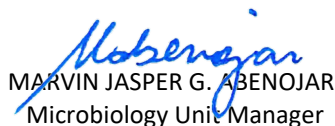
**METHOD REFERENCE:** Standard Methods for the Examination of Water and Wastewater, 24<sup>th</sup> Edition

**STANDARD REFERENCE:** Standard Limit is based on Philippine National Standards for Drinking Water of 2017


NOT VALID WITHOUT QR CODE




REVIEWED BY:

  
MARVIN JASPER G. ABENOJAR  
Microbiology Unit Manager

CERTIFIED CORRECT BY:

  
KRISTEEN Y. ALDAY, RCh  
Analytical Service Unit Manager  
License No(s). (PRC 0013295)

  
ANNA KARLA S. GUTIERREZ, RMT  
Laboratory Services Manager  
License No(s). (PRC 0060968)

**ADDRESS:** 8 North Science Avenue, Laguna Technopark Inc., Brgy. Biñan (Poblacion), Biñan City, Laguna

**CONTACT NO.:** (049) 543-1916

**WEBSITE:** [www.lagunawater.com.ph](http://www.lagunawater.com.ph)

**CUSTOMER NAME** : Laguna Water Corporation

**ADDRESS** : G/F, One Evotech Building, Nuvali, Brgy. Sto. Domingo, Sta. Rosa City, Laguna

**ATTENTION** : N/A

## SUMMARY OF LABORATORY ANALYSIS

**SAMPLE CODE(S)** : S25-4574

**DATE/TIME SUBMITTED** : 07/14/2025 13:33

**DATE/TIME COLLECTION** : 07/14/2025 10:10

**COLLECTED BY** : Edwin O. Aguilar

**NO. OF SAMPLES** : 1

**TOTAL PARAMETERS TESTED** : 4

**SAMPLE LOCATION** : CLUBHOUSE, AYALA GREENFIELDS ESTATE, BRGY. PUTING LUPA, CALAMBA CITY, LAGUNA

**SAMPLE CHARACTERISTICS** : 100 mL water sample in clear, polystyrene, sterile container with 3% sodium thiosulfate

PARAMETER(S)	UNIT(S)	RESULT(S)	PNSDW LIMIT(/S)	METHOD(S)	ANALYSIS	
					DATE	BY
*Residual Chlorine	mg/L	1.02	0.30 – 1.50	4500-Cl-G.DPD Colorimetric	07/14/2025	EOA
Total Coliform	Coliforms/100 mL	ABSENCE	ABSENCE	9223B. Enzyme Substrate Test (Colilert-18®)	07/14/2025	SBA
Thermotolerant Coliform / <i>Escherichia coli</i>	Coliforms/100 mL	ABSENCE	ABSENCE	9223B. Enzyme Substrate Test (Colilert-18®)	07/14/2025	SBA
Heterotrophic Plate Count (HPC) <sup>A</sup>	Colony Forming Unit (CFU)/mL	< 1	<500 (cfu/mL)	9215B. Pour Plate Method	07/14/2025	SBA

**REMARKS:** Sample collection was performed by LWC accredited samplers and was analyzed as submitted.

**NOTE:** A – Method is not part of DENR-ELR Recognized Parameters

\*- Performed onsite

**DEVIATIONS:** No deviations noted on sample collection and submission.


**METHOD REFERENCE:** Standard Methods for the Examination of Water and Wastewater, 24<sup>th</sup> Edition

**STANDARD REFERENCE:** Standard Limit is based on Philippine National Standards for Drinking Water of 2017


NOT VALID WITHOUT QR CODE




REVIEWED BY:

  
MARVIN JASPER G. ABENOJAR  
Microbiology Unit Manager

CERTIFIED CORRECT BY:

  
KRISTEEN Y. ALDAY, RCh  
Analytical Service Unit Manager  
License No(s). (PRC 0013295)

  
ANNA KARLA S. GUTIERREZ, RMT  
Laboratory Services Manager  
License No(s). (PRC 0060968)

**ADDRESS:** 8 North Science Avenue, Laguna Technopark Inc., Brgy. Biñan (Poblacion), Biñan City, Laguna

**CONTACT NO.:** (049) 543-1916

**WEBSITE:** [www.lagunawater.com.ph](http://www.lagunawater.com.ph)

**CUSTOMER NAME** : Laguna Water Corporation

**ADDRESS** : G/F, One Evotech Building, Nuvali, Brgy. Sto. Domingo, Sta. Rosa City, Laguna

**ATTENTION** : N/A

## SUMMARY OF LABORATORY ANALYSIS

**SAMPLE CODE(S)** : S25-4575

**DATE/TIME SUBMITTED** : 07/14/2025 13:33

**DATE/TIME COLLECTION** : 07/14/2025 11:30

**COLLECTED BY** : Edwin O. Aguilar

**NO. OF SAMPLES** : 1

**TOTAL PARAMETERS TESTED** : 4

**SAMPLE LOCATION** : WATER PUMP 1, AMAIA SCAPES CALAMBA, BRGY. BARANDAL, CALAMBA CITY, LAGUNA

**SAMPLE CHARACTERISTICS** : 100 mL water sample in clear, polystyrene, sterile container with 3% sodium thiosulfate

PARAMETER(S)	UNIT(S)	RESULT(S)	PNSDW LIMIT(/S)	METHOD(S)	ANALYSIS	
					DATE	BY
*Residual Chlorine	mg/L	0.70	0.30 – 1.50	4500-Cl-G.DPD Colorimetric	07/14/2025	EOA
Total Coliform	Coliforms/100 mL	ABSENCE	ABSENCE	9223B. Enzyme Substrate Test (Colilert-18®)	07/14/2025	SBA
Thermotolerant Coliform / <i>Escherichia coli</i>	Coliforms/100 mL	ABSENCE	ABSENCE	9223B. Enzyme Substrate Test (Colilert-18®)	07/14/2025	SBA
Heterotrophic Plate Count (HPC) <sup>A</sup>	Colony Forming Unit (CFU)/mL	< 1	<500 (cfu/mL)	9215B. Pour Plate Method	07/14/2025	SBA

**REMARKS:** Sample collection was performed by LWC accredited samplers and was analyzed as submitted.

**NOTE:** A – Method is not part of DENR-ELR Recognized Parameters

\*- Performed onsite

**DEVIATIONS:** No deviations noted on sample collection and submission.


**METHOD REFERENCE:** Standard Methods for the Examination of Water and Wastewater, 24<sup>th</sup> Edition

**STANDARD REFERENCE:** Standard Limit is based on Philippine National Standards for Drinking Water of 2017


NOT VALID WITHOUT QR CODE




REVIEWED BY:

  
MARVIN JASPER G. ABENOJAR  
Microbiology Unit Manager

CERTIFIED CORRECT BY:

  
KRISTEEN Y. ALDAY, RCh  
Analytical Service Unit Manager  
License No(s). (PRC 0013295)

  
ANNA KARLA S. GUTIERREZ, RMT  
Laboratory Services Manager  
License No(s). (PRC 0060968)

**ADDRESS:** 8 North Science Avenue, Laguna Technopark Inc., Brgy. Biñan (Poblacion), Biñan City, Laguna

**CONTACT NO.:** (049) 543-1916

**WEBSITE:** [www.lagunawater.com.ph](http://www.lagunawater.com.ph)

**CUSTOMER NAME** : Laguna Water Corporation

**ADDRESS** : G/F, One Evotech Building, Nuvali, Brgy. Sto. Domingo, Sta. Rosa City, Laguna

**ATTENTION** : N/A

## SUMMARY OF LABORATORY ANALYSIS

**SAMPLE CODE(S)** : S25-4576

**DATE/TIME SUBMITTED** : 07/14/2025 13:33

**DATE/TIME COLLECTION** : 07/14/2025 11:45

**COLLECTED BY** : Edwin O. Aguilar

**NO. OF SAMPLES** : 1

**TOTAL PARAMETERS TESTED** : 4

**SAMPLE LOCATION** : BLOCK 1 LOT 2, AMAIA SCAPES CALAMBA, BRGY. BARANDAL, CALAMBA CITY, LAGUNA

**SAMPLE CHARACTERISTICS** : 100 mL water sample in clear, polystyrene, sterile container with 3% sodium thiosulfate

PARAMETER(S)	UNIT(S)	RESULT(S)	PNSDW LIMIT(/S)	METHOD(S)	ANALYSIS	
					DATE	BY
*Residual Chlorine	mg/L	0.50	0.30 – 1.50	4500-Cl-G.DPD Colorimetric	07/14/2025	EOA
Total Coliform	Coliforms/100 mL	ABSENCE	ABSENCE	9223B. Enzyme Substrate Test (Colilert-18®)	07/14/2025	SBA
Thermotolerant Coliform / <i>Escherichia coli</i>	Coliforms/100 mL	ABSENCE	ABSENCE	9223B. Enzyme Substrate Test (Colilert-18®)	07/14/2025	SBA
Heterotrophic Plate Count (HPC) <sup>A</sup>	Colony Forming Unit (CFU)/mL	< 1	<500 (cfu/mL)	9215B. Pour Plate Method	07/14/2025	SBA

**REMARKS:** Sample collection was performed by LWC accredited samplers and was analyzed as submitted.

**NOTE:** A – Method is not part of DENR-ELR Recognized Parameters

\*- Performed onsite

**DEVIATIONS:** No deviations noted on sample collection and submission.

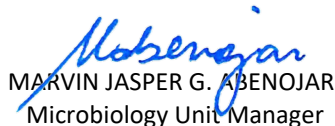
**METHOD REFERENCE:** Standard Methods for the Examination of Water and Wastewater, 24<sup>th</sup> Edition

**STANDARD REFERENCE:** Standard Limit is based on Philippine National Standards for Drinking Water of 2017


NOT VALID WITHOUT QR CODE




REVIEWED BY:

  
MARVIN JASPER G. ABENOJAR  
Microbiology Unit Manager

CERTIFIED CORRECT BY:

  
KRISTEEN Y. ALDAY, RCh  
Analytical Service Unit Manager  
License No(s). (PRC 0013295)

  
ANNA KARLA S. GUTIERREZ, RMT  
Laboratory Services Manager  
License No(s). (PRC 0060968)

**ADDRESS:** 8 North Science Avenue, Laguna Technopark Inc., Brgy. Biñan (Poblacion), Biñan City, Laguna

**CONTACT NO.:** (049) 543-1916

**WEBSITE:** [www.lagunawater.com.ph](http://www.lagunawater.com.ph)

**CUSTOMER NAME** : Laguna Water Corporation

**ADDRESS** : G/F, One Evotech Building, Nuvali, Brgy. Sto. Domingo, Sta. Rosa City, Laguna

**ATTENTION** : N/A

## SUMMARY OF LABORATORY ANALYSIS

**SAMPLE CODE(S)** : S25-4577

**DATE/TIME SUBMITTED** : 07/14/2025 13:33

**DATE/TIME COLLECTION** : 07/14/2025 12:01

**COLLECTED BY** : Edwin O. Aguilar

**NO. OF SAMPLES** : 1

**TOTAL PARAMETERS TESTED** : 4

**SAMPLE LOCATION** : WATER PUMP 2, AMAIA SCAPES CALAMBA, BRGY. BARANDAL, CALAMBA CITY, LAGUNA

**SAMPLE CHARACTERISTICS** : 100 mL water sample in clear, polystyrene, sterile container with 3% sodium thiosulfate

PARAMETER(S)	UNIT(S)	RESULT(S)	PNSDW LIMIT(/S)	METHOD(S)	ANALYSIS	
					DATE	BY
*Residual Chlorine	mg/L	0.68	0.30 – 1.50	4500-Cl-G.DPD Colorimetric	07/14/2025	EOA
Total Coliform	Coliforms/100 mL	ABSENCE	ABSENCE	9223B. Enzyme Substrate Test (Colilert-18®)	07/14/2025	SBA
Thermotolerant Coliform / <i>Escherichia coli</i>	Coliforms/100 mL	ABSENCE	ABSENCE	9223B. Enzyme Substrate Test (Colilert-18®)	07/14/2025	SBA
Heterotrophic Plate Count (HPC) <sup>A</sup>	Colony Forming Unit (CFU)/mL	< 1	<500 (cfu/mL)	9215B. Pour Plate Method	07/14/2025	SBA

**REMARKS:** Sample collection was performed by LWC accredited samplers and was analyzed as submitted.

**NOTE:** A – Method is not part of DENR-ELR Recognized Parameters

\*- Performed onsite

**DEVIATIONS:** No deviations noted on sample collection and submission.

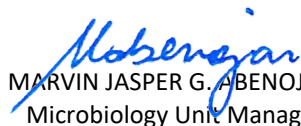
**METHOD REFERENCE:** Standard Methods for the Examination of Water and Wastewater, 24<sup>th</sup> Edition

**STANDARD REFERENCE:** Standard Limit is based on Philippine National Standards for Drinking Water of 2017


NOT VALID WITHOUT QR CODE




REVIEWED BY:

  
MARVIN JASPER G. ABENOJAR  
Microbiology Unit Manager

CERTIFIED CORRECT BY:

  
KRISTEEN Y. ALDAY, RCh  
Analytical Service Unit Manager  
License No(s). (PRC 0013295)

  
ANNA KARLA S. GUTIERREZ, RMT  
Laboratory Services Manager  
License No(s). (PRC 0060968)



**ADDRESS:** 8 North Science Avenue, Laguna Technopark Inc., Brgy. Biñan (Poblacion), Biñan City, Laguna

**CONTACT NO.:** (049) 543-1916

**WEBSITE:** [www.lagunawater.com.ph](http://www.lagunawater.com.ph)

**CUSTOMER NAME** : Laguna Water Corporation

**ADDRESS** : G/F, One Evotech Building, Nuvali, Brgy. Sto. Domingo, Sta. Rosa City, Laguna

**ATTENTION** : N/A

## SUMMARY OF LABORATORY ANALYSIS

**SAMPLE CODE(S)** : S25-4578

**DATE/TIME SUBMITTED** : 07/14/2025 13:33

**DATE/TIME COLLECTION** : 07/14/2025 12:18

**COLLECTED BY** : Edwin O. Aguilar

**NO. OF SAMPLES** : 1

**TOTAL PARAMETERS TESTED** : 4

**SAMPLE LOCATION** : BLOCK 39 LOT 5, AMAIA SCAPES CALAMBA, BRGY. BARANDAL, CALAMBA CITY, LAGUNA

**SAMPLE CHARACTERISTICS** : 100 mL water sample in clear, polystyrene, sterile container with 3% sodium thiosulfate

PARAMETER(S)	UNIT(S)	RESULT(S)	PNSDW LIMIT(/S)	METHOD(S)	ANALYSIS	
					DATE	BY
*Residual Chlorine	mg/L	0.34	0.30 – 1.50	4500-Cl-G.DPD Colorimetric	07/14/2025	EOA
Total Coliform	Coliforms/100 mL	ABSENCE	ABSENCE	9223B. Enzyme Substrate Test (Colilert-18®)	07/14/2025	SBA
Thermotolerant Coliform / <i>Escherichia coli</i>	Coliforms/100 mL	ABSENCE	ABSENCE	9223B. Enzyme Substrate Test (Colilert-18®)	07/14/2025	SBA
Heterotrophic Plate Count (HPC) <sup>A</sup>	Colony Forming Unit (CFU)/mL	< 1	<500 (cfu/mL)	9215B. Pour Plate Method	07/14/2025	SBA

**REMARKS:** Sample collection was performed by LWC accredited samplers and was analyzed as submitted.

**NOTE:** A – Method is not part of DENR-ELR Recognized Parameters

\*- Performed onsite

**DEVIATIONS:** No deviations noted on sample collection and submission.

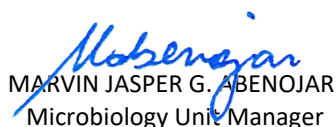
**METHOD REFERENCE:** Standard Methods for the Examination of Water and Wastewater, 24<sup>th</sup> Edition

**STANDARD REFERENCE:** Standard Limit is based on Philippine National Standards for Drinking Water of 2017

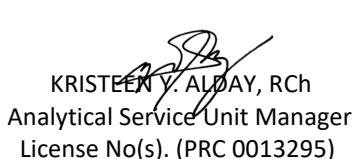
NOT VALID WITHOUT QR CODE

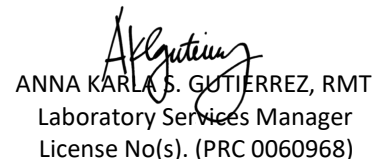


REVIEWED BY:

  
MARVIN JASPER G. ABENOJAR  
Microbiology Unit Manager

CERTIFIED CORRECT BY:

  
KRISTEEN Y. ALDAY, RCh  
Analytical Service Unit Manager  
License No(s). (PRC 0013295)

  
ANNA KARLA S. GUTIERREZ, RMT  
Laboratory Services Manager  
License No(s). (PRC 0060968)

**ADDRESS:** 8 North Science Avenue, Laguna Technopark Inc., Brgy. Biñan (Poblacion), Biñan City, Laguna

**CONTACT NO.:** (049) 543-1916

**WEBSITE:** [www.lagunawater.com.ph](http://www.lagunawater.com.ph)

**CUSTOMER NAME** : Laguna Water Corporation

**ADDRESS** : G/F, One Evotech Building, Nuvali, Brgy. Sto. Domingo, Sta. Rosa City, Laguna

**ATTENTION** : N/A

## SUMMARY OF LABORATORY ANALYSIS

**SAMPLE CODE(S)** : S25-4579

**DATE/TIME SUBMITTED** : 07/14/2025 13:33

**DATE/TIME COLLECTION** : 07/14/2025 11:14

**COLLECTED BY** : Edwin O. Aguilar

**NO. OF SAMPLES** : 1

**TOTAL PARAMETERS TESTED** : 4

**SAMPLE LOCATION** : WATER PUMP, NATIONAL UNIVERSITY, BRGY. MILAGROSA, CALAMBA CITY, LAGUNA

**SAMPLE CHARACTERISTICS** : 100 mL water sample in clear, polystyrene, sterile container with 3% sodium thiosulfate

PARAMETER(S)	UNIT(S)	RESULT(S)	PNSDW LIMIT(/S)	METHOD(S)	ANALYSIS	
					DATE	BY
*Residual Chlorine	mg/L	0.48	0.30 – 1.50	4500-Cl-G.DPD Colorimetric	07/14/2025	EOA
Total Coliform	Coliforms/100 mL	ABSENCE	ABSENCE	9223B. Enzyme Substrate Test (Colilert-18®)	07/14/2025	SBA
Thermotolerant Coliform / <i>Escherichia coli</i>	Coliforms/100 mL	ABSENCE	ABSENCE	9223B. Enzyme Substrate Test (Colilert-18®)	07/14/2025	SBA
Heterotrophic Plate Count (HPC) <sup>A</sup>	Colony Forming Unit (CFU)/mL	< 1	<500 (cfu/mL)	9215B. Pour Plate Method	07/14/2025	SBA

**REMARKS:** Sample collection was performed by LWC accredited samplers and was analyzed as submitted.

**NOTE:** A – Method is not part of DENR-ELR Recognized Parameters

\*- Performed onsite

**DEVIATIONS:** No deviations noted on sample collection and submission.


**METHOD REFERENCE:** Standard Methods for the Examination of Water and Wastewater, 24<sup>th</sup> Edition

**STANDARD REFERENCE:** Standard Limit is based on Philippine National Standards for Drinking Water of 2017


NOT VALID WITHOUT QR CODE




REVIEWED BY:

  
MARVIN JASPER G. ABENOJAR  
Microbiology Unit Manager

CERTIFIED CORRECT BY:

  
KRISTEEN Y. ALDAY, RCh  
Analytical Service Unit Manager  
License No(s). (PRC 0013295)

  
ANNA KARLA S. GUTIERREZ, RMT  
Laboratory Services Manager  
License No(s). (PRC 0060968)



**ADDRESS:** 8 North Science Avenue, Laguna Technopark Inc., Brgy. Biñan (Poblacion), Biñan City, Laguna

**CONTACT NO.:** (049) 543-1916

**WEBSITE:** [www.lagunawater.com.ph](http://www.lagunawater.com.ph)

**CUSTOMER NAME** : Laguna Water Corporation

**ADDRESS** : G/F, One Evotech Building, Nuvali, Brgy. Sto. Domingo, Sta. Rosa City, Laguna

**ATTENTION** : N/A

## SUMMARY OF LABORATORY ANALYSIS

**SAMPLE CODE(S)** : S25-4580

**DATE/TIME SUBMITTED** : 07/14/2025 13:33

**DATE/TIME COLLECTION** : 07/14/2025 10:59

**COLLECTED BY** : Edwin O. Aguilar

**NO. OF SAMPLES** : 1

**TOTAL PARAMETERS TESTED** : 4

**SAMPLE LOCATION** : EDUCATION BUILDING, NATIONAL UNIVERSITY, BRGY. MILAGROSA, CALAMBA CITY, LAGUNA

**SAMPLE CHARACTERISTICS** : 100 mL water sample in clear, polystyrene, sterile container with 3% sodium thiosulfate

PARAMETER(S)	UNIT(S)	RESULT(S)	PNSDW LIMIT(/S)	METHOD(S)	ANALYSIS	
					DATE	BY
*Residual Chlorine	mg/L	0.30	0.30 – 1.50	4500-Cl-G.DPD Colorimetric	07/14/2025	EOA
Total Coliform	Coliforms/100 mL	ABSENCE	ABSENCE	9223B. Enzyme Substrate Test (Colilert-18®)	07/14/2025	SBA
Thermotolerant Coliform / <i>Escherichia coli</i>	Coliforms/100 mL	ABSENCE	ABSENCE	9223B. Enzyme Substrate Test (Colilert-18®)	07/14/2025	SBA
Heterotrophic Plate Count (HPC) <sup>A</sup>	Colony Forming Unit (CFU)/mL	< 1	<500 (cfu/mL)	9215B. Pour Plate Method	07/14/2025	SBA

**REMARKS:** Sample collection was performed by LWC accredited samplers and was analyzed as submitted.

**NOTE:** A – Method is not part of DENR-ELR Recognized Parameters

\*- Performed onsite

**DEVIATIONS:** No deviations noted on sample collection and submission.


**METHOD REFERENCE:** Standard Methods for the Examination of Water and Wastewater, 24<sup>th</sup> Edition

**STANDARD REFERENCE:** Standard Limit is based on Philippine National Standards for Drinking Water of 2017


NOT VALID WITHOUT QR CODE




REVIEWED BY:

  
MARVIN JASPER G. ABENOJAR  
Microbiology Unit Manager

CERTIFIED CORRECT BY:

  
KRISTEEN Y. ALDAY, RCh  
Analytical Service Unit Manager  
License No(s). (PRC 0013295)

  
ANNA KARLA S. GUTIERREZ, RMT  
Laboratory Services Manager  
License No(s). (PRC 0060968)